

AQUABLEND 2000 THERMOSTATIC MIXING VALVE

Installation Instructions

FOR USE IN AUSTRALIA



WaterMark

AS/NZS 4032.1

Lic1593

I00109_Sep20

IS226

Call 1300 369 273
www.enware.com.au



Enware Australia Pty Limited
9 Endeavour Rd Caringbah NSW 2229 Australia
Ph: 02 8536 4000 info@enware.com.au

AQUABLEND 2000 THERMOSTATIC MIXING VALVE

The ENWARE AQUABLEND 2000 Thermostatic Mixing Valve is a high performance Thermostatic Mixing Valve suitable for a wide range of applications. The valve is designed to comply with AS4032.1 - Thermostatic Mixing Valves.

PRODUCT FEATURES

- Complies with the requirements of AS4032.1 -Thermostatic Mixing Valves
- Provides high stability of mixed water temperature even under changing inlet conditions
- Ensures rapid shut down of mixed outlet flow in the event of hot or cold water supply failure
- Designed for quick and simple in-situ servicing
- Suitable for installation into AS3500 compliant systems with hot water temperature as low as 55°C for temperature differential
- Fitted with a Tamper Resistant temperature adjustment mechanism

CONTENTS

SAFETY	page 3
PRODUCT DESCRIPTION	page 4
RECOMMENDED PRESSURES AND TEMPERATURES	page 7
FLOW SIZING GRAPH	page 8
INSTALLATION	page 9
COMMISSIONING OF THE VALVE	page 12
MAINTENANCE & SERVICING	page 15
TROUBLE SHOOTING	page 17
SPARE PARTS	page 19
COMMISSIONING REPORT	page 20
SERVICING REPORT	page 23
WARRANTY	page 26

Enware reserves the right to change any product specification or information contained in this publication, at any time and without notice. Every care has been taken to ensure accuracy in the Preparation of this publication which has been issued for guidance only. No liability can be accepted for any consequences which may arise as a result of its application. Enware = trade mark of Enware Australia Pty Limited.

Aquablend TMV's are exclusively manufactured for Enware Australia Pty Limited by Reliance Worldwide, 27-28 Chapman Place, Eagle Farm, Qld, 4009 Australia.

SAFETY

The ENWARE AQUABLEND 2000 Thermostatic Mixing Valve is a high performance valve designed to give stable and dependable operation, provided it is installed, commissioned, operated and maintained as per the recommendations outlined in this manual. It should be noted however that this valve should not be considered as an alternative to adequate supervision and duty of care during its use and operation.

Note: When installed, the mixing valve, inlet controls, pipework and the surrounding area may become hot, which may cause burn injuries. Precautions should be taken to ensure that these surfaces cannot cause such injuries.

PRODUCT DESCRIPTION

The ENWARE AQUABLEND 2000 Thermostatic Mixing Valve is available in two variations, complete with inlet service fittings. The inlet to the fittings is $\frac{1}{2}$ " BSP male for ATM711 (discontinued), and $\frac{3}{4}$ " BSP female for ATM713. The outlet from both valves is $\frac{3}{4}$ " BSP male. The service fittings consist of isolating ball valves, strainers, pressure test points and non-return valves. The strainers can be serviced and cleaned without disturbing the installation (refer to Maintenance & Servicing Pg 15). The inlet service fittings also incorporate union type fittings enabling the thermostatic mixing valve to be removed from its installation without disturbing its pipework.

The schematics and dimensions of the Aquablend 2000 Male & Female valves and corresponding order codes are shown below in Figure 1 and Figure 2 respectively.

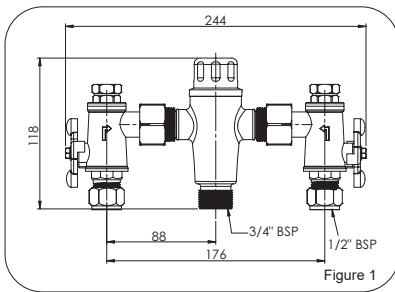


Figure 1 - Physical Size
AQUABLEND 2000 – Polished, chrome plated finish on the body & inlet fittings. $\frac{1}{2}$ " BSP Male Inlet fittings with compression nuts. $\frac{3}{4}$ " BSP Male Outlet Fitting. Dry Weight 1.7kg
ORDER CODE ATM711
(Discontinued Model)

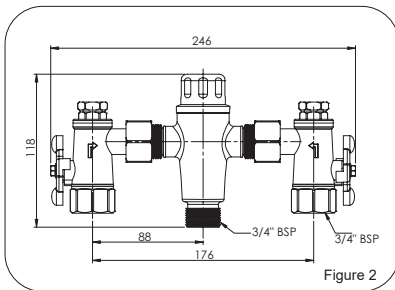



Figure 2 - Physical Size
AQUABLEND 2000 – Polished, chrome plated finish on the body & inlet fittings. $\frac{3}{4}$ " BSP Female Inlet fittings. $\frac{3}{4}$ " BSP Male Outlet Fitting. Dry Weight 1.7kg
ORDER CODE ATM713

Figure 3 (below) shows a general arrangement drawing of the ENWARE AQUABLEND 2000 Thermostatic Mixing Valve showing the method of operation.

Hot and cold water is supplied to each side of the valve respectively. The hot water enters through a port below the Piston, the cold water enters above the Piston. Upon entry the water begins to blend and enters the Mixing Tube. At this point the mixed water contacts the thermostatic wax Element. The Element will extend or contract to match the water temperature it is exposed to causing the Piston to move, thereby regulating the amounts of hot and cold water entering the valve. This thermostatic mechanism maintains the mixed water temperature at a constant temperature.

If for example the inlet hot pressure dropped, the flow of hot water into the valve would be reduced and the valve would react as per the following sequence of events:

- Element is exposed to mixed water at a reduced temperature
- Thermostatic Element contracting
- Piston is pushed upwards by the return spring restricting cold

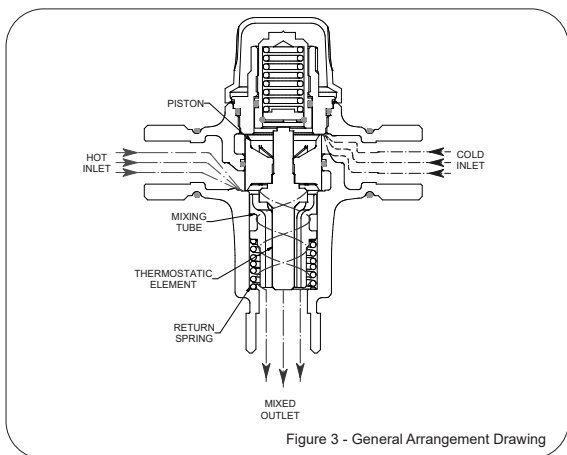

flow, consequently opening more of hot port

- Valve attempts to restore itself to original temperature setting

Similarly if the hot inlet temperature dropped, the element would again see blended water at a lower temperature and therefore the Element would again contract reducing the cold port piston gap and hence supply more hot water and less cold. Once again the valve attempts to restore itself to its original setting. This will occur for all changing conditions including changes to flow rate, inlet temperatures and inlet pressures.

In the event of a sudden loss of the cold water supply the Piston will shut off the hot port thus stopping any flow through the valve. The valve will also shut down the cold supply if there is a hot water failure.

RECOMMENDED PRESSURES & TEMPERATURES

MIXED OUTLET TEMPERATURE		
Temperature Adjustment Range		38-50°C
INLET TEMPERATURES		
Cold Supply	Minimum	5°C
	Maximum	30°C
Hot Supply	Minimum	55°C
	Maximum	90°C
Hot to Mix Temperatures Differential for Stable Operation	Minimum	10°C
Cold to Mix Temperatures Differential for Stable Operation	Minimum	5°C
FLOW RATES - TO ENSURE STABLE CONDITIONS		
Minimum	2 lpm (4 lpm recommended for optimum performance)	
Maximum	38 litres/min @ 300kPA Pressure loss as per flow sizing graph	
DYNAMIC INLET PRESSURES		
Hot & Cold Inlet Pressures **	Minimum	20kPa
	Maximum	500kPa
STATIC INLET PRESSURES		
Hot & Cold Inlet Pressures	Maximum	1600kPa
INLET PRESSURE RATIO		
$H - PL = H^1$ $C - PL = C^1$ $H^1 : C^1 = \text{Max } 10:1$ $C^1 : H^1 = \text{Max } 10:1$	$H = \text{Hot inlet pressure}$ $C = \text{Cold inlet pressure}$ $PL = \text{Pressure Loss}$ Refer to page 25 - Appendix 1 for more information	

** AS3500.4 clause 1.9.4.2 - The dynamic pressure differential between hot and cold supplies when mixed at a thermostatic mixing valve shall not exceed 10%.

NOTE: Notwithstanding the above, compliance with AS3500 must be maintained.

FLOW SIZING GRAPH

The ENWARE AQUABLEND 2000 Thermostatic Mixing Valve is suitable for many applications. The Headloss Characteristic for Mixed Outlet Flowrate versus Balanced Inlet Pressure is shown below in Figure 4. It is important that the valve is not oversized for its intended application.

HEADLOSS CHARACTERISTICS OF AQUABLEND 2000

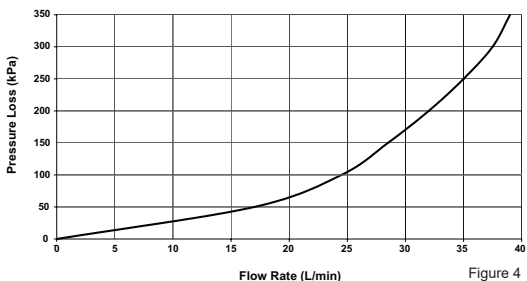


Figure 4

NOTE: Stable temperature water is available at 2 litres/minute however to ensure optimum performance it is recommended the minimum outlet flow of the mixing valve during operation should be 4 litres/minute.

It is important that the valve is sized such that the flow rates from the outlets are not less than those listed in AS3500.1 Sec 3. The pipework between the valve and the system must be sized in accordance with AS3500.1 to ensure the water velocity in the pipework is within the allowed limit.

If the valve is to be installed and operated under unequal inlet pressures the lower inlet pressure determines the outlet flow rate. However, for optimum performance and stability it is recommended that the valve be installed with balanced dynamic inlet pressures (+/- 10%).

INSTALLATION

The ENWARE AQUABLEND 2000 Thermostatic Mixing Valve should be installed using the appropriate Standard, Code of Practice and Legislation applicable to each state and following the details outlined in this section.

The ENWARE AQUABLEND 2000 must be installed by a licensed plumber, or where applicable, a licensed plumber who has undertaken T.A.F.E. or equivalent accredited training in Thermostatic Mixing Valves.

NOTE: *To effectively control microbial hazards during system design, installation, commissioning and maintenance, the requirements outlined in AS/NZS3666 and local legislation shall be adhered to.*

Inlet connections on the valve are clearly marked. **The hot inlet is indicated by a red identification ring on the inlet and the cold inlet by a blue identification ring.**

If the valve is not installed correctly then it will not function correctly and may put the user in danger. It may also void the warranty of the valve.

Prior to the installation of the valve, the system must be checked to ensure that the system operating conditions fall within the recommended operating range of the AQUABLEND 2000 Thermostatic Mixing Valve as detailed on page 7. **If the hot water supply temperature is greater than 90°C the valve may be damaged.** A suitable temperature limiting valve must be fitted to the hot water supply, prior to the inlet fittings, if the temperature of the hot water will rise above 90°C. This temperature limiting valve must be installed as per the manufacturer's instructions.

It is also important that both of the inlet dynamic supply pressures are 500kPa or less. If either supply pressure exceeds 500kPa then a suitable pressure reducing valve must be fitted prior to the inlet control valve to reduce the pressure to an acceptable limit. These pressure reducing valves must be installed as per the manufacturer's instructions. In order to achieve optimum performance from the valve it is

recommended that the inlet pressures are balanced to within 10% of each other. The water quality conditions should be checked to ensure they do not exceed the limits as listed in Section 1.6 of AS3500.4. If they do exceed these limits then it will be necessary to install a water softener or water treatment device.

NOTE: In some installations where certain types of tapware, such as flick mixers and solenoid valves, are used; the water pressure may be seen to spike outside that recommended for the valve during rapid shut off conditions with these types of devices. Even if the spike only lasts a split second it is still considered to be outside the operating conditions and may cause the valve to operate incorrectly. In the event that this does occur measures must be taken to control the spike, such as inline pressure reducing valves directly before the valve inlets.


To ensure that the mixing valve operates correctly it is necessary that the pipework is thoroughly flushed with clean water before the valve is installed. This will remove any physical contaminants from the pipework, ensuring trouble-free operation. During the flushing procedure care should be taken to prevent water damage occurring to the surrounding area.

It is required by AS3500.4 Sec 3 that “*Each Thermostatic Mixing Valve shall have an isolating stop tap/valve, line strainer and non-return valve fitted to the hot and cold water supply lines*”. The inlet fittings supplied with each TMV will ensure this requirement is met. If the ENWARE AQUABLEND 2000 Thermostatic Mixing Valve is to be installed without the supplied inlet control valves then it will be necessary to install a separate isolating valve, non-return valve and strainer to both inlets to the valve. Strainers must be fitted to prevent any particulate contamination from entering the valve. These strainers should be 60 Mesh stainless steel. Isolating valves are required so that the water supply to the valve can be

isolated in the event that servicing is required. Non-return devices must also be fitted to both the hot and cold inlets to prevent cross-connection.

The valve should be installed so it can be accessed easily for maintenance or servicing. The valve can be installed in a wall cavity, under a basin or on a wall, however it is essential that the mixing valve and inlet fittings are easily accessible for servicing.

During installation or servicing heat must not be applied near the mixing valve or inlet fittings, as this will damage the valve and inlet fitting internals. Failure to comply with this requirement will damage the valve and fittings. It will put the user at risk, and it will void the warranty of the valve.

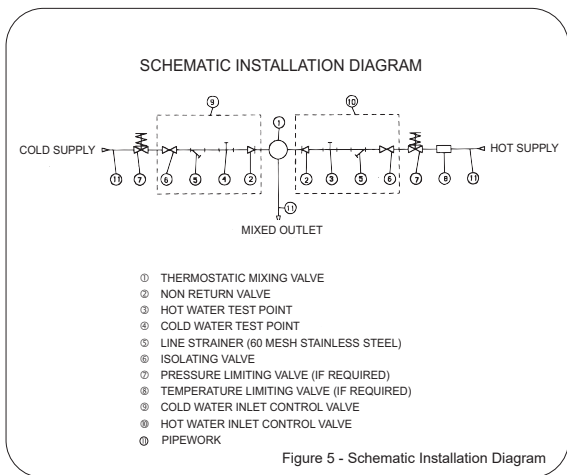

COMMISSIONING OF THE VALVE

Upon completion of the installation, the valve should be tested & commissioned as per the procedure outlined below or as specified by the local authority. The entire procedure should be read through thoroughly prior to the commissioning of the valve. A calibrated digital thermometer having rapid response time with maximum temperature hold, small flat bladed screwdriver and the adjusting key (supplied with the AQUABLEND 2000) will be required to check & set the outlet mixed temperature of the valve. Enware provides a complete test kit for this procedure.

(Order Code ATMS1200)

- Ensure all outlets that will be serviced by the valve have adequate warning signs posted to ensure that no outlet is used during commissioning
- Open the cold supply line to the valve, then open the hot supply line, ensuring there are no leaks
- Open the outlet that is serviced by the shortest length of pipe work between the mixing valve and outlet fixture
- Allow the mixed outlet to flow for at least 60 seconds to allow the temperature to stabilise before taking a temperature reading at the outlet with a digital thermometer. For optimum performance the flow rate should be at least 4 litres/min. The flow rate can be checked with the aid of a known size container and a stopwatch or an Enware Flow Cup ATMS1201 supplied with Test Kit ATMS1200. The temperature should be taken at the closest outlet served by the thermostatic mixing valve. If the outlet temperature requires adjustment the following steps are required:

TEMPERATURE ADJUSTMENT

1. Using a small flat bladed screw driver lever the protective cover off the valve (Figure 6). (over page)
2. Fit the supplied key over the adjusting spindle (Figure 7)
 - To **increase** the mixed outlet temperature, rotate the spindle **anti-clockwise**
 - To **decrease** the mixed outlet temperature, rotate the spindle **clockwise**
3. Allow the mixed outlet temperature to stabilize for 60

seconds and once again take a temperature reading. Repeat the procedure until the desired temperature has been reached.

4. Push the top cover firmly on to the top of the valve until it 'snaps' back into place.
5. Check that the outlet temperature is stable over the full range of flow rates and that the flow rate is adequate for the application.
6. Close the outlet.
7. The mixing valve is now set and locked.

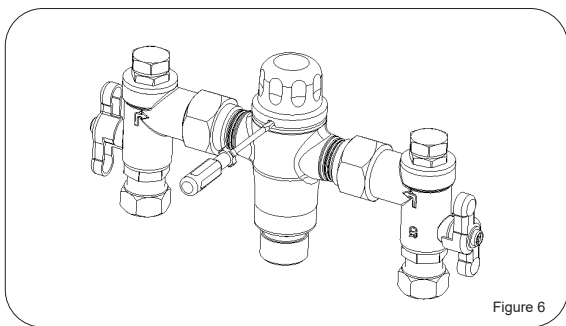


Figure 6

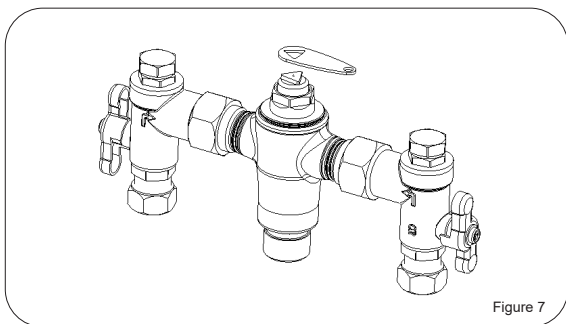


Figure 7

Ensure that the test plugs in the top of the inlet fittings are tight

SHUT DOWN TEST

Now that the mixing valve has been set and locked it is necessary to perform a shut down check.

- Allow the mixed water temperature to stabilise and note the outlet temperature. While holding a digital thermometer in the outlet flow, quickly isolate the cold water supply to the valve. The outlet flow should quickly cease flowing. As a guide the flow should be less than 0.2 litre/min following the isolation. Monitor the maximum outlet flow temperature, record this on the Commissioning Report (page 20). The temperature should not exceed that allowed by the applicable standard or code of practice for each state. Restore the cold water supply to the valve. After the mixed water temperature has stabilised note the outlet temperature ensuring the outlet temperature has re-established.
- Repeat the above test, except this time quickly isolate the hot water supply to the valve. The outlet flow should quickly slow to a trickle - as a guide typically less than 0.4 litre/min@500kPa down to less than 0.2litre/min@100kPa following the isolation. Restore the hot water supply to the valve and measure and record in the Commissioning Report (page 20) the outlet temperature after the mixed water temperature has stabilised ensuring the outlet temperature has re-established.
- Ensure that all details of the Commissioning Report are completed & signed by the relevant signatories & a copy is kept with the installer and owner of the premises.

The valve is now commissioned and it can be used within the technical limits of operation.

MAINTENANCE AND SERVICING

The ENWARE AQUABLEND 2000 Thermostatic Mixing Valve will only require minimal preventative maintenance work to ensure it operates at its optimum level of performance. The valve should be commissioned, and serviced in accordance with AS4032.3 and the manufacturing specifications.

ANNUAL MAINTENANCE PROCEDURE

The ENWARE AQUABLEND 2000 should be inspected & tested every twelve months in accordance with AS4032.3. Record all results in the Servicing Report (refer to page 23)

- The external valve surface should be lightly wiped down
- The valve & surrounding area should be inspected for leaks or water damage and appropriate action taken if required
- Ensure a clean dry work area is available

A) Cleaning the Strainers

- Isolate the hot and cold supplies to the mixing valve by closing the inlet ball valves
- Remove the inlet fitting top cover with a suitable spanner and then remove the mesh strainer, as shown in Figure 8
- The strainers should be cleaned with a dilute water solution of suitable descaling solvent (such as CLR), checked for physical damage and then thoroughly rinsed with clean water
- The strainers can then be re-installed into the inlets and the top cover returned and tightened to a maximum torque of 15Nm into the inlet valve bodies. Check that the test plug in the top of the inlet fittings are tight, then re-open the Isolating valves and check there is no evidence of water leakage

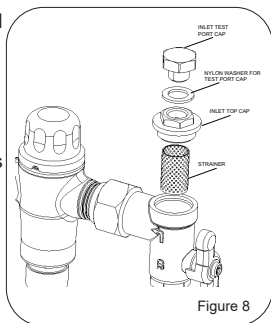


Figure 8

B) Non-Return Valve Operation

Check Non-Return Valves on the HOT inlet side - visual inspection.

- Turn OFF the isolation tap on the HOT inlet only (COLD inlet must be open)
- Open Test Port Cap on the HOT inlet side
- Observe water level in the HOT inlet side test port. If there is a rising water level this may indicate a fouled or faulty Non-Return Valve - replace if required
- Replace the test port cap on HOT inlet side ensuring it is tightly secured
- Turn back ON the isolation tap on the HOT inlet

Check Non-Return Valves on the COLD inlet side repeating steps above using the COLD inlet side.

C) Discharge temperature measured at the nearest outlet to the valve for high and low flow

D) The cold water shut-off operation

E) The hot water shut-off operation

Where a device is not functioning in accordance with the application requirements, the problem shall be rectified or the device replaced - refer to the Troubleshooting on page 17.

5-YEAR SERVICE

In addition to the Annual Maintenance, the valve piston O-ring and Thermostatic Element/ Piston Assembly must be replaced at intervals not exceeding 5 years from commissioning.

For re-greasing of O-rings, use the grease supplied with Aquablend Service Kit or use food grade silicone based grease (e.g. Molykote 111, Clare FU5, Hydroseal).

TROUBLESHOOTING

FAULT/ SYMPTOM	CAUSE	RECTIFICATION
The desired mixed water temperature cannot be obtained or valve is difficult to set	<ul style="list-style-type: none"> • Hot and cold supplies are fitted to the wrong connections • Valve contains debris • Strainers contain debris • Non-return devices are damaged • Top Cap and/or Piston O-rings are damaged 	<ul style="list-style-type: none"> • Refit the valve with Hot/ Cold supplies fitted to the correct connections • Clean the valve ensuring that all debris is removed and components are not damaged • Clean strainers ensuring debris is removed • Check non-return device is not jammed. Clean it if necessary • Check Top Cap & Piston O-rings for damage. Replace if necessary
The valve will not shut down	<ul style="list-style-type: none"> • The hot to mix temperature differential is not 10°C or greater • The piston O-ring is damaged • Valve body seat (Hot Seat is damaged or fouled by debris • Cold seat (bottom surface of Top Cap) is damaged • Thermostatic element has failed • Plastic shuttle of Thermostatic element has been damaged by debris 	<ul style="list-style-type: none"> • Raise hot water temperature • Replace piston O-ring • Clean seat using mild descaling solution • Replace top cap • Replace element
Mix temperature unstable	<ul style="list-style-type: none"> • Debris is fouling valve • Flow rate below 2L/min • Strainers are fouled 	<ul style="list-style-type: none"> • Clean valve ensuring all debris is removed & components aren't damaged • Rectify any pressure deterioration. Increase flow rate to minimum of 4 litres/ min • Clean strainers
Mix temperature changing over time	<ul style="list-style-type: none"> • Inlet conditions (pressures or temperatures) are fluctuating • Strainers contain debris 	<ul style="list-style-type: none"> • Install suitable pressure control valves to ensure inlet conditions are within those stated on Page 7 • Clean strainers ensuring debris is removed

TROUBLESHOOTING

FAULT/ SYMPTOM	CAUSE	RECTIFICATION
Either full hot or cold flowing from outlet fixture	<ul style="list-style-type: none"> • Valve is incorrectly set. • Hot/Cold water has migrated to other inlet • Refer also to fault/symptom 1 & 2 	<ul style="list-style-type: none"> • Adjust mix temperature between 38 - 50°C as required • Replace faulty non-return valves
No flow from the valve outlet	<ul style="list-style-type: none"> • Hot or cold water failure • Strainers are fouled 	<ul style="list-style-type: none"> • Valve functioning correctly - shut down due to inlet supply failure. Restore inlet supplies and check mix temperature • Clean strainers
Flow rate reduced or fluctuating	<ul style="list-style-type: none"> • Valve or inlet fittings fouled by debris • Dynamic inlet pressures are not within recommended limits 	<ul style="list-style-type: none"> • Check valve and inlet fittings for blockages • Ensure operating conditions are within specified limits and the dynamic inlet pressures are nominally balanced to within +/- 10%
Mixed water temperature too hot or cold	<ul style="list-style-type: none"> • Valve has been tampered with • Valve incorrectly set • Inlet temperatures are not within specified limits 	<ul style="list-style-type: none"> • Readjust valve to required set temperature • Readjust valve to required set temperature • Ensure inlet temperatures are within the specified limits as listed on Page 7
Mixed water temperature not changing when the temperature adjuster is altered	<ul style="list-style-type: none"> • Return spring is missing • Thermostatic element has failed 	<ul style="list-style-type: none"> • Install return spring • Replace piston/thermostatic element
Mixed water temperature adjuster difficult to move	<ul style="list-style-type: none"> • Adjuster at maximum mix temperature stop • Valve piston into overstroke 	<ul style="list-style-type: none"> • Mixed water is at maximum temperature. No higher mix temperature adjustment is available • Wind adjuster out until set temperature required is achieved
Hot water flows into the cold water system or vice versa	<ul style="list-style-type: none"> • Non-return valve 	<ul style="list-style-type: none"> • Replace non-return valves
Valve is noisy	<ul style="list-style-type: none"> • Water velocity above velocity requirements of AS3500.1 Sec 3.4 	<ul style="list-style-type: none"> • Reduce water velocity

SPARE PARTS

PART	REPLACEMENT TIME	PART NUMBER
5 Year Service Kit (includes O-rings, element and piston assembly plus top cap with thermal flush)	5 years	ATMS242
O-Ring Kit	when required	ATMS123

OLD STYLE

Pressure Test Point Plug With Washer (Each)
ATMS1314

Pressure Test Point Washer Only (Each)
ATMS1204

Pressure Test Point Plug With O-Ring (Pair)
ATMS238

Inlet Cap to suit ATMS238 (Each)
ATMS244

Inlet Fitting Strainers (Pair)
ATMS205

Inlet Fitting Control Valve
3/4" FI Hot - **ATMS705**
3/4" FI Cold - **ATMS703**
1/2" MI Hot - **ATMS501**
1/2" MI Cold - **ATMS502**

5 YEAR SERVICE KIT
ATMS242

Element and Piston Assembly
ATMS1400

O-Ring Kit
ATMS123

Face Seals (Pair)
ATMS213

Wall Mount Bracket
ATMS214

Temperature Adjuster Key
ATMS514

Lock Shield

Top Cap Assembly
ATMS1401

Mixing Tube
ATMS228

Return Spring
ATMS190

Inlet Fitting O-Ring (Pair)
ATMS202

Non-Return Valve (Each)
ATMS212



ATMS1200 - Aquablend Test Kit



ATMS1221 - Pete's Plug 1/4" Test Point Adaptor

COMMISSIONING REPORT

Enware Thermostatic Mixing Valve Commissioning Report For Thermostatic Mixing Valves use a separate sheet for each valve

Establishment					
Address					
Phone No		Contact			
Date		Work Order No.			
Make & Model of Hot Water Unit					
Hot Water	Pressure	kPa	Cold Water	Pressure	kPa
	Temp	°C		Temp	°C
Cold Water Supply via			Pressure Reducing Valve Fitted	YES/NO	
Make of Mixing Valve			Model No		
			Size		
Valve Location / Building					
Valve ID No.			Total No. of Mixing Valves on Site/ Building		
Total No. of outlets served by this valve	Baths		Basins	Showers	
Other outlet details					
Valve installed to requirements of					
The drawing & specification	The valve manufacture / supplier		The code of TMV's	The local water supply authority	
YES/NO	YES/NO		YES/NO	YES/NO	
If NO, give details and action taken					

Test results (complete table on following page)		
Valve considered satisfactory for use	YES/NO	
If NO, state reason and action taken		
It is hereby certified that all the commissioning work has been carried out by the undersigned in accordance with local plumbing requirements for Thermostatic Mixing Valves		
Date initial service due:		(Maximum 12 months use)
Valve commissioned by:		
Signature Licensed Plumber		Lic/Cert No
Business name of Plumbing Contractor		
Contractors Authority No		Date

NOTE: A duplicate copy of this report is to be retained at the site for any inspection by authorised persons.

The following information is to be provided by site manager/owner:

Valve size and installation recommended by (name)		
Valve supplied by (name)		
Valve installed by (name)		
Date of installation:	Drawing No:	
Certificate of Compliance/Inspection No:	Dated:	
Service manual on site: YES/NO		
Report received by (name)		
Position		
Signature		Date:
For and on behalf of the client/site manager/owner		

Test results

Valve location/building	
Room or area designation	
Work Order No	

Warm water outlet fixture No.	Name/type/ size & location of outlet fixture (bath, shower, basin or other)	Flow rate of design warm water (L/sec)		Temp of warm water °C	
		1 outlet in use	** All req. outlets in use	1 outlet in use	** All req. outlets in use
1.					
2.					
3.					
4.					
5.					
6.					
7.					
8.					

Give details of brand and model designation. Commensurate with the design flow rate for the mixing valve.

NOTE: An accurate digital type thermometer is necessary for the temperature measurements.

Prescribed temperature range for warm water	°C to °C
Fail safe at both minimum and maximum design flow rates	PASSED/FAILED
Signature of licensed plumber	
Licence/Cert No	
Business name of plumbing contractor	
Contractor's authority No:	Date:

SERVICING REPORT

Enware Thermostatic Mixing Valve Servicing Report

use a separate sheet for each valve

Establishment			
Address			
Phone No		Contact	
Date		Work Order No.	
Make & Model of Hot Water Unit			
Mixing Valve Make:	Model No:		
	Size		
Valve Location / Building			
Valve ID No.		Total No. of Mixing Valves on Site/ Building	
Total No. of outlets served by this valve	Baths	Basins	Showers
Other outlet details			

Valve installed to requirements of:

The drawing & specification	The code of TMV's	The code of TMV's	The local water supply authority
YES/NO	YES/NO	YES/NO	YES/NO

If NO, give details and action taken

Any current complaints concerning installation or operation reported or stated in previous report If YES, give details:		YES/NO
Particulars of service work carried out during this visit		
List of items replaced (and part numbers) during this visit:		
Warm water temp. at outlet °C	Fail Safe Test	PASSED / FAILED
Valve considered satisfactory for further use		YES/NO
If NO, reason and action taken:		
Date next service due (12 months maximum):		

It is hereby certified that all the commissioning work has been carried out by the undersigned in accordance with local plumbing requirements for Thermostatic Mixing Valves

Signature Licensed Plumber		Lic/Cert No
Business name of Plumbing Contractor		
Contractors Authority No		Date

NOTE: A duplicate copy of this report is to be retained at the site for any inspection by authorised persons.

The following information is to be provided by site manager/owner:

Valve size and installation recommended by (name)		
Valve supplied by (name)		
Valve installed by (name)		
Date of installation:	Drawing No:	
Certificate of Compliance/Inspection No:	Dated:	
Service manual on site: YES/NO		
Report received by (name)		
Position		
Signature		Date:

For and on behalf of the client/site manager/owner

Appendix 1 - The Pressure Loss Ratio Calculation

At all times the conditions at the valve must be within the specified pressure loss ratio to ensure that the outlet temperature remains within the stated limits.

Pressure Loss Ratio is determined as follows:

At the valve, the difference between the cold inlet pressure and the outlet pressure (back pressure) under flow conditions is the pressure loss across the cold side. Similarly for the hot side. The ratio of the larger pressure loss over the smaller pressure loss gives the pressure loss ratio. For example, with a cold supply pressure of 500 kPa, a hot supply pressure of 250 kPa and a back pressure of 200 kPa (under flow conditions), the pressure loss ratio is

$$= (\text{cold pressure} - \text{back pressure}) / (\text{hot pressure} - \text{back pressure})$$

$$= (500 - 200) / (250 - 200)$$

$$= 300 / 50$$

$$= 6 : 1 \text{ pressure loss ratio}$$

Note - the inlet supply pressures alone will not give an accurate indication of the pressure loss ratio! (In this case a 2:1 inlet supply pressure ratio is actually a 6:1 pressure loss ratio under flow conditions.)

Note also - the static supply pressures give absolutely no indication whatsoever of the pressure loss ratio. Only pressures under flow conditions should be used to calculate pressure loss ratio.

PRODUCT WARRANTY

The ENWARE AQUABLEND 2000 Thermostatic Mixing Valve is guaranteed free from manufacturing defects for a period of 24 months*, subject to the conditions outlined below:

Enware Product Warranty

Subject to the warranty conditions and exclusions set out below ENWARE valves are warranted to be free from defects in material and/or workmanship for a period of 24 months service life and if found by ENWARE to be so defective will be replaced as set out below. If the valve is sold by a party other than ENWARE then it is sold by that seller as principal and the seller has no authority from ENWARE to give any additional warranty on behalf of ENWARE.

The benefits of this warranty are in addition to all other rights and remedies which the purchaser may have under the Trade Practices Act (Cwth) or similar laws of each State and Territory in Australia.

Warranty Conditions

The valve must have been installed by a licensed plumber in accordance with the ENWARE Installation Instructions and Application Guidelines supplied with the valve, and in accordance with the National Plumbing and Drainage Code AS3500 (the Code) current at the date of installation and all relevant statutory and local requirements in the State or Territory in which the valve is installed.

Where the valve is installed outside the boundaries of a metropolitan area as defined by ENWARE, the cost of transport insurance and travelling shall be the purchaser's responsibility. (Refer to the ENWARE scale of fees for replacement of valves).

Where the valve comprises part of a hot water system, installation of that system must be in accordance with its manufacturer's recommendations, the Code and all relevant statutory and local State or Territory requirements.

* 5 Years Conditional Warranty: 2 years parts and labour on the complete assembly; an additional 3 years parts supply only on the valve body excluding inlet fitting assemblies.

The valve must be returned to ENWARE with a fully & correctly completed Online Product and Service Warranty Form: www.enware.com.au/product-service-enquiry .

Where the valve is replaced under warranty the replacement valve carries a new warranty as detailed herein.

Warranty Exclusions

Replacement work will be carried out as set out in the ENWARE Warranty above, but the following exclusions may cause the warranty to become void, and may incur a service charge including cost of parts where:

Damage has been caused by accident, Acts of God, misuse, incorrect installation of the hot water system of which the valve forms a part or attempts to disassemble the valve.

It is found that there is nothing wrong with the valve.

The failure of the valve is due in part or in whole to faulty manufacture/installation of the hot water system of which the valve forms part.

The valve has failed directly or indirectly as a result of excessive water pressure or temperature outside the Application Guidelines, thermal input or corrosive environment.

The valve has failed due to foreign matter either from installation or the water supply.

The failure of the valve is due to scale formation in the waterways of the valve.

The failure of the valve is due in part, or in whole, to installation not in conformance with the requirements of the Code.

ENWARE reserves the right to change its specifications without prior notice and will not accept liability for any claim arising from such change.

Subject to any statutory provisions to the contrary, claims for damage to furniture, carpets, walls, foundations or any other consequential loss either directly or indirectly due to leakage from the valve are also excluded from warranty cover.



ADDRESS: 9 Endeavour Rd Caringbah NSW 2229 Australia

POSTAL ADDRESS: P.O. Box 2545, Taren Point NSW 2229 Australia

PHONE: +61 2 8556 4000

1300 369 273 [AUS] WWW.ENWARE.COM.AU INFO@ENWARE.COM.AU

ABN 23 003 988 314

